

Class I
Item no. 950011.R9
2005-11-16

General Specification

V90 – 3.0 MW

50 Hz, OptiSpeed™ Wind Turbine

| Contents..... | Page |
|--|-------------|
| 1. General Description | 4 |
| 1.1 Nacelle Description | 4 |
| 1.2 Rotor V90 | 6 |
| 1.3 Control and Regulation..... | 7 |
| The VMP controller is equipped with a battery backup system. | 8 |
| 1.4 Monitoring | 8 |
| 1.5 Lightning Protection..... | 9 |
| 1.6 Service | 10 |
| 2. Main Data | 11 |
| 2.1 Power Curve, Calculated..... | 11 |
| 2.2 Annual Production V90 - 3.0MW | 17 |
| 2.3 Noise Curves V90 - 3.0 MW | 18 |
| 3. Micro Siting and Network Connection..... | 23 |
| 3.1 Siting in Wind Farms | 23 |
| 3.2 Terrain Conditions | 23 |
| 3.3 Connection to the Electrical Power Grid..... | 23 |
| 4. General Ambient Design Criteria | 24 |
| 4.1 General Conditions..... | 24 |
| 4.2 Wind Conditions | 24 |
| 5. Type Approvals..... | 25 |
| 6. Options | 25 |
| 6.1 Advanced Grid Option 2 | 25 |
| 6.2 Extended UPS..... | 25 |
| 6.3 High Voltage Switchgear | 26 |
| 6.4 Obstruction Light | 26 |
| The options are designed according to the ICAO and the FAA codes. | 26 |
| 6.5 Service Lift inside the Tower | 26 |
| 6.6 Wind Turbine Colour | 26 |
| 7. Technical Specifications and Diagrams | 27 |
| 7.1 Rotor | 27 |
| 7.2 Hub..... | 27 |
| 7.3 Blades | 27 |
| 7.4 Bearings | 27 |
| 7.5 Sensors | 27 |
| 7.6 Generator | 28 |
| 7.7 Transformer..... | 28 |
| 7.8 Switchgear, Electrical Characteristics | 29 |
| 7.9 Yaw System | 29 |
| 7.10 Yaw Gears | 29 |
| 7.11 Gearbox | 30 |
| 7.12 Parking Brake..... | 30 |
| 7.13 Hydraulics | 30 |
| 7.14 Cooling System | 30 |
| 7.15 Nacelle Bedplate | 30 |
| 7.16 Nacelle | 31 |
| 7.17 Tower | 31 |
| 7.18 Weight and Dimensions | 31 |

8. General Reservations, Notes and Disclaimers33

1. General Description

The Vestas V90 - 3.0 MW is a pitch regulated upwind wind turbine with active yaw and a three-blade rotor.

The Vestas V90 - 3.0 MW has a rotor diameter of 90 m with a generator rated at 3.0 MW.

The turbine utilises the OptiTip® and OptiSpeed™ concepts. With these features the wind turbine is able to operate the rotor at variable speed (RPM), maintaining the output at rated power even in high wind speeds. At low wind speeds, the OptiTip® and OptiSpeed™ systems work together to maximise the power output by giving the optimal RPM and pitch angle, which also helps to minimise the sound emission from the turbine.

1.1 Nacelle Description

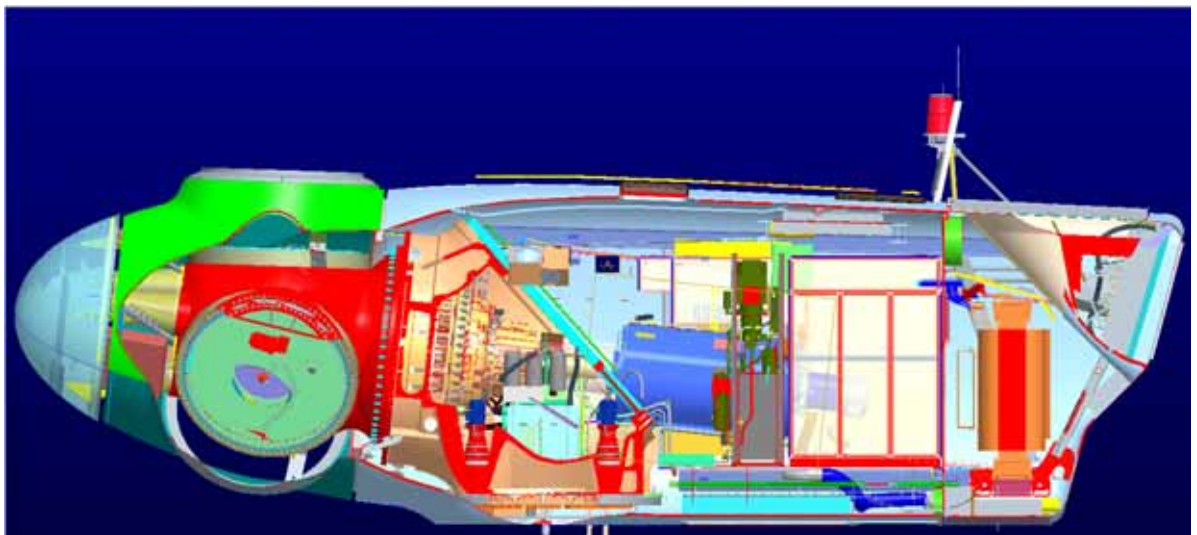


Figure 1 V90 - 3.0MW nacelle

The nacelle cover is made of fibreglass. An opening in the floor provides access to the nacelle from the tower.

The roof section is equipped with skylights which can be opened to access the roof and the wind sensors.

Wind sensors are mounted on the nacelle roof. Aviation lights, if any, are also placed on top of the nacelle.

1.1.1 Machine Foundation (Bedplate)

The front of the nacelle bedplate is the foundation for the drive train, which transmits forces and torque from the rotor to the tower through the yaw system. The front of

the nacelle bedplate is made of cast steel. The nacelle cover is mounted on the nacelle bedplate.

The nacelle bedplate is in two parts consisting of a cast iron part and a girder structure.

The cast iron part serves as the foundation of the main gear and the generator.

The bottom surface is machined and connected to the yaw bearing. The crane beams are attached to the top structure. The lower beams of the girder structure are connected at the rear end. The rear part of the bedplate serves as the foundation for the controller panels, cooling system and transformer.

The six yaw gears are bolted to the nacelle bedplate.

The nacelle houses the internal 800 kg Safe Working Load (SWL) service crane.

The crane is a single system chain hoist. If any parts heavier than this need service, the service crane can be upgraded to 1600/12000 kg SWL.

The upgraded crane is able to lift and lower large elements, such as parts of the gearbox and the generator.

1.1.2 Gearbox

The main gear transmits the torque from the rotor to the generator.

The gear unit is a combination of a 2-stage planetary gear and a 1-stage helical gear. The gear housing is bolted to the bedplate. The low speed input shaft is bolted directly to the hub without the use of a traditional main shaft.

The gearbox lubrication system is a forced feed system without the use of an integrated oil sump.

1.1.3 Yaw System

The yaw bearing system is a plain bearing system with built-in friction. The six electrical yaw gears with motor brakes enables the nacelle to rotate on top of the tower. The system transmits the forces from the turbine rotor/nacelle to the tower.

1.1.4 The Brake System

The turbine brakes by full-feathering the rotor blades. The individual pitch cylinders ensure triple braking safety.

Furthermore, a hydraulic system supplies pressure to a disc brake located on the main gear high-speed shaft. The disc brake system consists of three hydraulic brake callipers and serves as the parking brake. The parking brake can only be activated manually by pressing an emergency stop button inside the turbine.

1.1.5 Generator

The generator is an asynchronous 4-pole generator with a wound rotor.

OptiSpeed™ enables the turbine to operate with variable speed. This reduces power fluctuations in the power grid system as well as minimises the loads on vital parts of the turbine. Furthermore, the OptiSpeed™ system optimises the power pro-

duction, especially at low wind speeds. The OptiSpeed™ technology enables control of the turbine reactive power factor between 0.96 inductive and 0.98 capacitive measured on the low voltage side.
The generator is water-cooled.

1.1.6 Transformer

The step-up transformer is located in a separate compartment to the rear of the nacelle. The transformer is a three-phase dry-type cast resin transformer specially designed for wind turbine applications.

The windings are delta connected on the high voltage side, unless otherwise specified. The windings are connected in star on the low voltage side (1000 V and 400 V). The 1000 V and 400 V systems in the nacelle are a TN system, where the star point is connected to ground.

Surge arresters are mounted on the high voltage (primary) side of the transformer. The output voltages available are in 0.5 kV steps from 10 to 33 kV, where 36kV (U_m) is the highest equipment peak voltage.

The transformer room is equipped with arc detection sensors.

1.1.7 The Cooling and Air Conditioning System

If the inside air temperature of the nacelle exceeds a certain level, flap valves will open to the outside. A fan engine will draw in outside air for cooling the nacelle air.

Gear lubrication oil, generator cooling water and the OptiSpeed™ unit are cooled from a separate air intake, using separate water/air cooling systems. Water coolers are thermally insulated from other parts of the nacelle.

A separate fan cools the transformer.

The heat exchanger system is mounted in a separate compartment in the upper rear section of the nacelle.

1.2 Rotor V90

1.2.1 Hub / Nose Cone

The hub is mounted directly onto the gearbox, hereby eliminating the main shaft traditionally used to transmit the wind power to the generator through the gearbox.

1.2.2 Pitch Regulation

The V90 is equipped with a microprocessor-controlled pitch control system called OptiTip®. Based on the prevailing wind conditions, the blades are continuously positioned at the optimum pitch angle.

The pitch mechanism is placed in the hub. Changes of the blade pitch angle are made by hydraulic cylinders, which are able to rotate the blade 95°. Each blade has its own hydraulic pitch cylinder.

1.2.3 Hydraulics

A hydraulic system generates hydraulic pressure for the pitch systems in the hub. In case of grid failure or leakage, a backup accumulator system provides sufficient pressure to pitch the blades and stop the turbine.

A collector system prevents oil leaks, if any, from spreading outside the hub.

1.2.4 Blades

The blades are made of fibreglass and carbon fibre reinforced epoxy. Each blade consists of two blade shells bonded to a supporting spar. The blades are designed for optimum output and minimum noise and light reflection. The V90 blade design minimises the mechanical loads applied to the turbine.

The blade bearing is a double raced 4-point ball bearing bolted to the blade hub. Each blade has a lightning protection system consisting of lightning receptors on the blade tip and a copper wire conductor inside the blade.

1.3 Control and Regulation

1.3.1 OptiSpeed™ Description

OptiSpeed™ ensures a steady and stable electric power production from the turbine.

The OptiSpeed™ system consists of an asynchronous generator with wound rotor and slip rings. A back-to-back power converter with IGBT switches, contactors and protection enables the turbine to operate with variable speed.

The OptiSpeed™ and OptiTip® systems ensure energy optimisation, low noise operation and reduction of loads on all vital components.

The system controls the current in the rotor circuit of the generator giving precise control of the reactive power and provides for a smooth connection sequence when the generator is connected to the grid.

The reactive power control is as default set at 0 kVAr export/import at 1000 V.

1.3.2 Vestas Multi Processor Controller

All functions of the wind turbine are monitored and controlled by microprocessor based control units called VMP (Vestas Multi Processor).

The VMP controller consists of several individual sub-controller systems. Each system has separate operation tasks and communicates via an optical-based network (ArcNet).

The controller enclosures are located in the bottom of the tower, in the nacelle and in the hub.

The operating system is VxWorks®, which fulfils the demands for stability, flexibility and security that are expected in a modern, intelligent wind turbine.

Digital and analogue input/output functions in the turbine are interfaced via the use of distributed units communicating on the CAN-open protocol.

The VMP controller is equipped with a battery backup system.

The VMP controller serves the following functions:

- Monitoring and supervision of overall operation.
- Synchronising the generator to the grid during the connection sequence in order to limit the inrush current.
- Operating of the turbine during various fault situations.
- Automatic yawing of the nacelle in accordance to the wind direction.
- OptiTip® - blade pitch control.
- OptiSpeed™ - reactive power control and variable speed operation.
- Noise emission control.
- Monitoring of ambient conditions (wind, temperature etc).
- Monitoring of the grid.
- Monitoring and logging of lightning strikes.
- Supervision of the smoke detection system.
- De-rating in case of critically high temperatures.

1.3.2.1 Active Damping of Drive Train Torsional Oscillations in OptiSpeed™ Controlled Turbines

Oscillations which may occur in the drive train can be monitored by measuring the number of revolutions and can be damped via an active control of the generator. If the oscillations exceed a certain limit, the Active Control system is activated in order to stop further escalations of the drive train oscillations.

1.3.2.2 Improving Grid Quality (Active Harmonics Damping) in OptiSpeed™ Controlled Turbines

OptiSpeed™ contributes to reducing the 5th and 7th harmonic components on the grid and to reducing the interharmonic components produced by the induction generator slip. The compensation reduces the network harmonics to below 2% of nominal current.

1.4 Monitoring

1.4.1 Sensors

Data for controlling the turbine and the energy production is received from different sensors measuring:

- Weather conditions: Wind direction, wind speed and temperature.
- Machine conditions: Temperatures, oil level and pressure, cooling water level.
- Rotor activity: Speed and pitch position.
- Construction: Vibrations, lightning detectors.
- Grid connection: Active power, reactive power, voltage, current, frequency, $\cos\phi$.

1.4.2 Sensor Features

1.4.2.1 Ultrasonic Wind Sensors

The nacelle is equipped with two redundant ultrasonic wind sensors in order to increase the reliability and accuracy of the wind measurements. The wind sensors measure the wind direction and wind speed.

The sensor is self-testing, and if the sensor signal is defective, the turbine will be brought to a safe condition.

To improve performance during icy conditions, the sensors are equipped with a heating element.

The sensors are located on top of the nacelle and are protected against lightning strokes.

1.4.2.2 Smoke Detectors

The tower and nacelle are equipped with optical smoke sensors. If smoke is detected, an alarm is sent via the remote control system and the main switcher is activated. The detectors are self-controlling. If a detector becomes defective, a warning is sent via the remote control system.

1.4.2.3 Lightning Detectors

Lightning detectors are located in each rotor blade.

1.4.2.4 Accelerometers

Accelerometers register the movements of the tower top. The registrations are intelligent controlled by the VMP and used to stop the turbine if the movements and vibrations exceeds predefined limits. The accelerometers allow turbines with high towers to run with a rotor RPM closer to the tower natural frequency.

1.4.2.5 GPS (Real Time Clock)

The GPS is primarily used to synchronise the turbine clock. The GPS accuracy is within 1 second. Via this system it is possible to compare the various log observations with other turbines within the same area/site. E.g. fluctuations in the power, grid or lightning activity.

1.4.2.6 Arc Protection

The transformer and the low voltage switchboards are protected by an arc protection system. In case of an electrical arc, the system will instantly open the main breaker downstream from the turbine.

1.5 Lightning Protection

The V90 wind turbine is equipped with Vestas Lightning Protection, which protects the entire turbine from the tip of the blades to the foundation. The system enables the lightning current to by-pass all vital components within the blade, nacelle and

tower without causing damage. As an extra safety precaution, the control units and processors in the nacelle are protected by an efficient shielding system.

The lightning protection is designed according to IEC 61024 - "Lightning Protection of Wind Turbine Generators".

Lightning detectors are mounted on all three rotor blades. Data from the detectors are logged and enable the operator to identify which of the blades were hit, the exact time of the stroke and how powerful the lightning was.

These data are very useful for making a remote estimate of possible damages to the turbine and the need for inspection.

1.6 Service

The turbine will need a scheduled Service check every 12 months.

1.6.1 Lubrication of Components

- Blade bearings: Automatic lubrication from an electrically driven unit. Re-fill every 12 months.
- Generator bearings: Automatically lubricated via the gear oil system.
- Gearbox: The oil is collected in a tank. From the collection tank the oil is pumped to a heat exchanger and back to the gearbox. The pumps distribute the oil to the gear wheels and bearings.
- Yaw gear: Lubrication in sealed oil bath, which is inspected every 12 months.
- Yaw system: Lubricated with an automatic grease system
- Hydraulic system: The oil level is inspected every 12 months.

2. Main Data

2.1 Power Curve, Calculated

Calculated at 1000V / 400V, low voltage side of the high voltage transformer.

2.1.1 Power Curve, Mode 0 - 109.4 dB(A)

| V90 - 3.0 MW, 50 Hz, Mode 0 - 109.4 dB(A) | | | | | | | | | | | | |
|---|----------------------------------|------|------|------|------|------|------|------|------|-------|------|------|
| Wind Speed [m/s] | Air Density [kg/m ³] | | | | | | | | | | | |
| | 0.97 | 1 | 1.03 | 1.06 | 1.09 | 1.12 | 1.15 | 1.18 | 1.21 | 1.225 | 1.24 | 1.27 |
| 4 | 53 | 56 | 59 | 61 | 64 | 67 | 70 | 72 | 75 | 77 | 78 | 81 |
| 5 | 142 | 148 | 153 | 159 | 165 | 170 | 176 | 181 | 187 | 190 | 193 | 198 |
| 6 | 271 | 281 | 290 | 300 | 310 | 319 | 329 | 339 | 348 | 353 | 358 | 368 |
| 7 | 451 | 466 | 482 | 497 | 512 | 528 | 543 | 558 | 574 | 581 | 589 | 604 |
| 8 | 691 | 714 | 737 | 760 | 783 | 806 | 829 | 852 | 875 | 886 | 898 | 921 |
| 9 | 995 | 1028 | 1061 | 1093 | 1126 | 1159 | 1191 | 1224 | 1257 | 1273 | 1289 | 1322 |
| 10 | 1341 | 1385 | 1428 | 1471 | 1515 | 1558 | 1602 | 1645 | 1688 | 1710 | 1732 | 1775 |
| 11 | 1686 | 1740 | 1794 | 1849 | 1903 | 1956 | 2010 | 2064 | 2118 | 2145 | 2172 | 2226 |
| 12 | 2010 | 2074 | 2137 | 2201 | 2265 | 2329 | 2392 | 2454 | 2514 | 2544 | 2573 | 2628 |
| 13 | 2310 | 2382 | 2455 | 2525 | 2593 | 2658 | 2717 | 2771 | 2817 | 2837 | 2856 | 2889 |
| 14 | 2588 | 2662 | 2730 | 2790 | 2841 | 2883 | 2915 | 2940 | 2958 | 2965 | 2971 | 2981 |
| 15 | 2815 | 2868 | 2909 | 2939 | 2960 | 2975 | 2984 | 2990 | 2994 | 2995 | 2996 | 2998 |
| 16 | 2943 | 2965 | 2979 | 2988 | 2993 | 2996 | 2998 | 2999 | 2999 | 3000 | 3000 | 3000 |
| 17 | 2988 | 2994 | 2997 | 2998 | 2999 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 18 | 2998 | 2999 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 19 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 20 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 21 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 22 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 23 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 24 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 25 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |

Wind speed as 10 minute average value at hub height and perpendicular to the rotor plane.

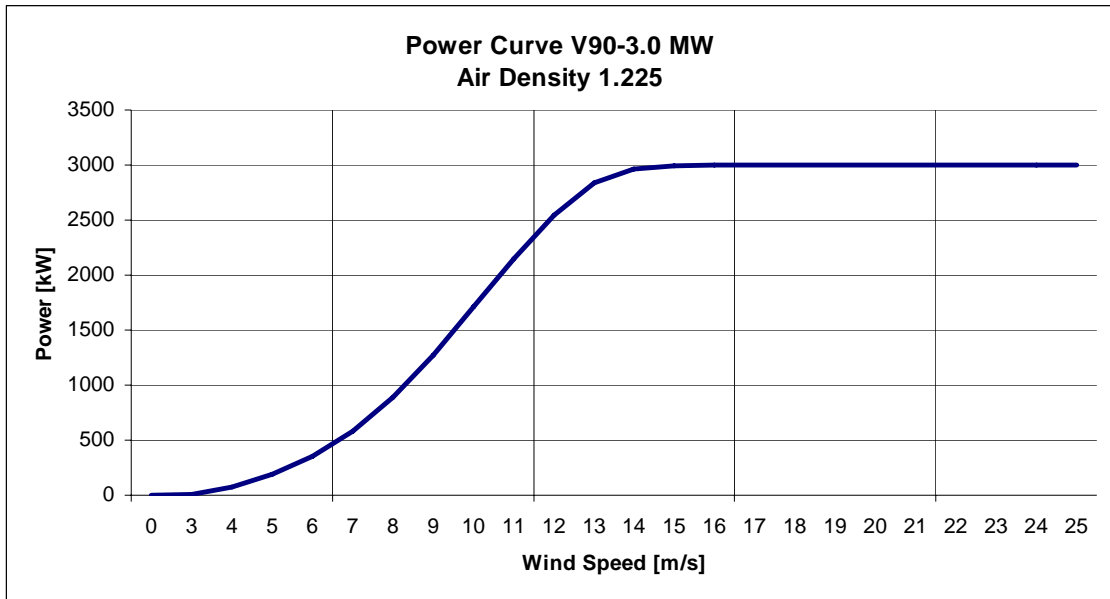


Figure 2 Power curve for Vestas V90 - 3.0 MW, 50 Hz Mode 0 - 109.4 dB(A).

2.1.2 Power Curve, Mode 1 - 107.8 dB(A)

| V90 - 3.0 MW, 50 Hz, Mode 1 - 107.8 dB(A) | | | | | | | | | | | | |
|---|----------------------------------|------|------|------|------|------|------|------|------|-------|------|------|
| Wind Speed [m/s] | Air Density [kg/m ³] | | | | | | | | | | | |
| | 0.97 | 1 | 1.03 | 1.06 | 1.09 | 1.12 | 1.15 | 1.18 | 1.21 | 1.225 | 1.24 | 1.27 |
| 4 | 53 | 56 | 59 | 61 | 64 | 67 | 70 | 72 | 75 | 77 | 78 | 81 |
| 5 | 142 | 148 | 153 | 159 | 165 | 170 | 176 | 181 | 187 | 190 | 193 | 198 |
| 6 | 271 | 281 | 290 | 300 | 310 | 319 | 329 | 339 | 348 | 353 | 358 | 368 |
| 7 | 451 | 466 | 482 | 497 | 512 | 528 | 543 | 558 | 574 | 581 | 589 | 604 |
| 8 | 691 | 714 | 737 | 760 | 783 | 806 | 829 | 852 | 875 | 886 | 898 | 921 |
| 9 | 994 | 1027 | 1060 | 1092 | 1125 | 1157 | 1190 | 1223 | 1255 | 1272 | 1288 | 1321 |
| 10 | 1330 | 1373 | 1416 | 1460 | 1503 | 1546 | 1589 | 1632 | 1675 | 1696 | 1718 | 1761 |
| 11 | 1656 | 1709 | 1762 | 1815 | 1868 | 1921 | 1974 | 2027 | 2080 | 2106 | 2133 | 2186 |
| 12 | 1963 | 2026 | 2088 | 2151 | 2213 | 2276 | 2338 | 2399 | 2459 | 2489 | 2518 | 2575 |
| 13 | 2258 | 2329 | 2400 | 2470 | 2539 | 2605 | 2666 | 2723 | 2774 | 2797 | 2818 | 2856 |
| 14 | 2539 | 2614 | 2684 | 2748 | 2804 | 2851 | 2889 | 2919 | 2942 | 2951 | 2959 | 2971 |
| 15 | 2778 | 2837 | 2883 | 2919 | 2946 | 2964 | 2977 | 2985 | 2991 | 2993 | 2994 | 2996 |
| 16 | 2925 | 2953 | 2971 | 2983 | 2990 | 2994 | 2997 | 2998 | 2999 | 2999 | 2999 | 3000 |
| 17 | 2983 | 2991 | 2995 | 2997 | 2999 | 2999 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 18 | 2997 | 2999 | 2999 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 19 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 20 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 21 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 22 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 23 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 24 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 25 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |

Wind speed as 10 minute average value at hub height and perpendicular to the rotor plane.

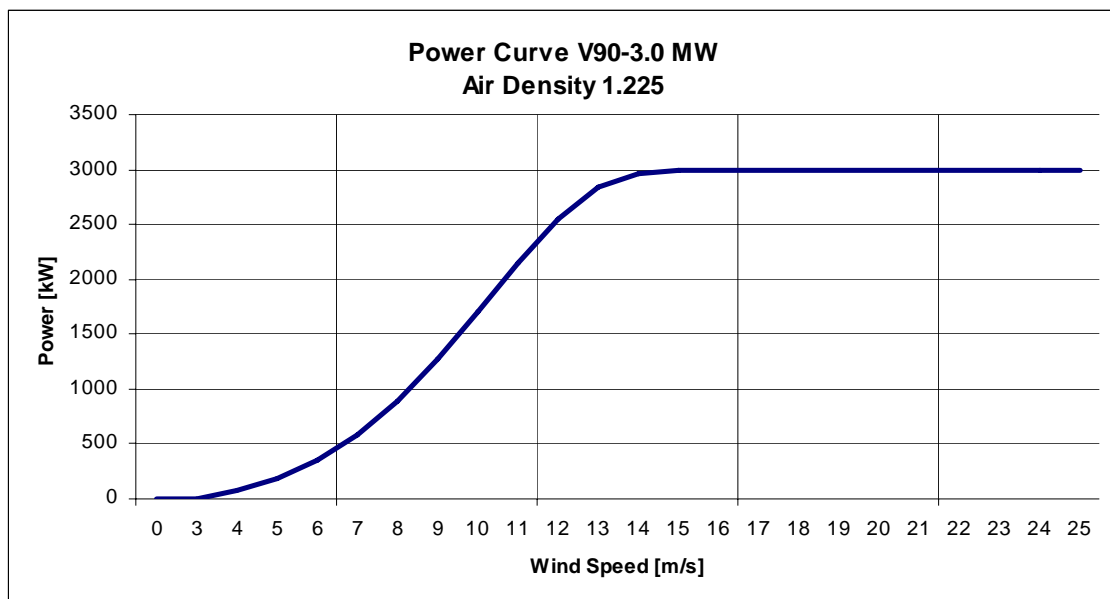


Figure 3 Power curve for Vestas V90 - 3.0 MW, 50 Hz, Mode 1 - 107.8 dB(A).

2.1.3 Power Curve, Mode 2 - 106.8 dB(A)

| V90 - 3.0 MW, 50 Hz, Mode 2 - 106.8 dB(A) | | | | | | | | | | | | |
|---|----------------------------------|------|------|------|------|------|------|------|------|-------|------|------|
| Wind Speed [m/s] | Air Density [kg/m ³] | | | | | | | | | | | |
| | 0.97 | 1 | 1.03 | 1.06 | 1.09 | 1.12 | 1.15 | 1.18 | 1.21 | 1.225 | 1.24 | 1.27 |
| 4 | 53 | 56 | 59 | 61 | 64 | 67 | 70 | 72 | 75 | 77 | 78 | 81 |
| 5 | 142 | 148 | 153 | 159 | 165 | 170 | 176 | 181 | 187 | 190 | 193 | 198 |
| 6 | 271 | 281 | 290 | 300 | 310 | 319 | 329 | 339 | 348 | 353 | 358 | 368 |
| 7 | 451 | 466 | 482 | 497 | 512 | 528 | 543 | 558 | 574 | 581 | 589 | 604 |
| 8 | 691 | 713 | 736 | 759 | 782 | 805 | 828 | 851 | 874 | 885 | 897 | 920 |
| 9 | 984 | 1016 | 1048 | 1080 | 1113 | 1145 | 1177 | 1209 | 1242 | 1258 | 1274 | 1306 |
| 10 | 1286 | 1328 | 1370 | 1412 | 1453 | 1495 | 1537 | 1578 | 1620 | 1641 | 1662 | 1703 |
| 11 | 1575 | 1625 | 1676 | 1726 | 1777 | 1827 | 1878 | 1928 | 1979 | 2004 | 2029 | 2080 |
| 12 | 1852 | 1911 | 1970 | 2029 | 2088 | 2147 | 2206 | 2265 | 2324 | 2353 | 2382 | 2439 |
| 13 | 2119 | 2186 | 2253 | 2320 | 2387 | 2453 | 2518 | 2581 | 2642 | 2671 | 2699 | 2749 |
| 14 | 2376 | 2451 | 2524 | 2595 | 2662 | 2724 | 2781 | 2829 | 2871 | 2888 | 2904 | 2928 |
| 15 | 2624 | 2697 | 2763 | 2820 | 2867 | 2905 | 2934 | 2955 | 2970 | 2976 | 2981 | 2987 |
| 16 | 2828 | 2879 | 2917 | 2946 | 2965 | 2978 | 2987 | 2992 | 2995 | 2997 | 2997 | 2998 |
| 17 | 2944 | 2966 | 2980 | 2989 | 2994 | 2996 | 2998 | 2999 | 2999 | 3000 | 3000 | 3000 |
| 18 | 2987 | 2993 | 2996 | 2998 | 2999 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 19 | 2998 | 2999 | 2999 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 20 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 21 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 22 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 23 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 24 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 25 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |

Wind speed as 10 minute average value at hub height and perpendicular to the rotor plane.

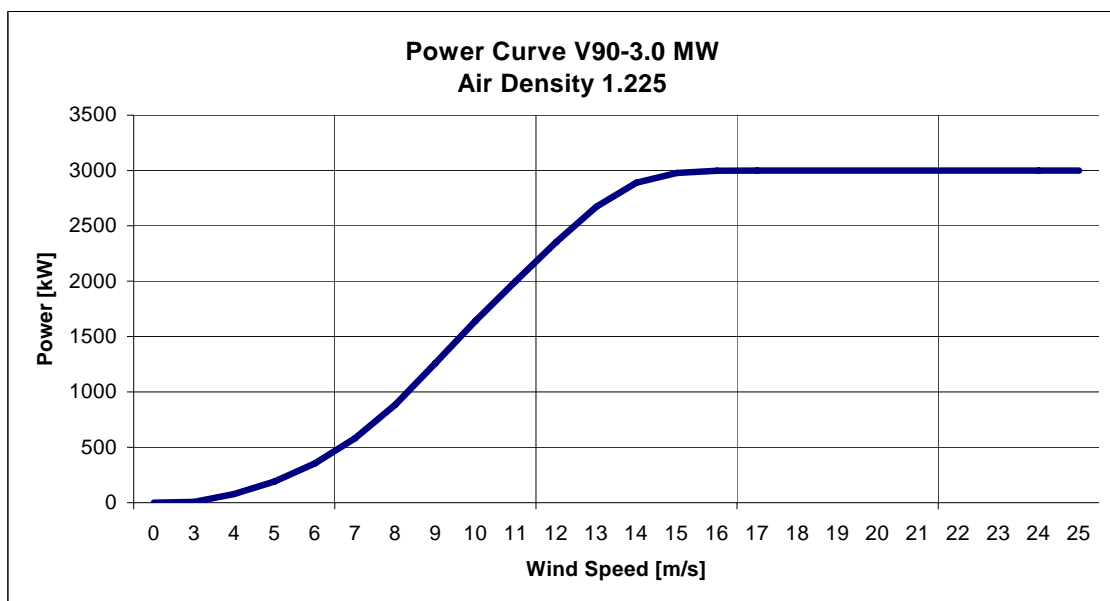


Figure 4 Power curve for Vestas V90 - 3.0 MW, 50 Hz, Mode 2 - 106.7.

2.1.4 Power Curve, Mode 3 - 104.4 dB(A)

| V90 - 3.0 MW, 50 Hz, Mode 3 - 104.4 dB(A) | | | | | | | | | | | | |
|---|------|------|------|------|------|------|------|------|------|-------|------|------|
| Air Density [kg/m ³] | | | | | | | | | | | | |
| Wind Speed [m/s] | 0.97 | 1 | 1.03 | 1.06 | 1.09 | 1.12 | 1.15 | 1.18 | 1.21 | 1.225 | 1.24 | 1.27 |
| 4 | 53 | 56 | 58 | 61 | 64 | 67 | 70 | 72 | 75 | 77 | 78 | 81 |
| 5 | 142 | 148 | 153 | 159 | 165 | 170 | 176 | 181 | 187 | 190 | 193 | 198 |
| 6 | 271 | 281 | 290 | 300 | 310 | 319 | 329 | 339 | 348 | 353 | 358 | 368 |
| 7 | 451 | 466 | 481 | 497 | 512 | 527 | 543 | 558 | 573 | 581 | 588 | 604 |
| 8 | 680 | 703 | 725 | 748 | 770 | 793 | 815 | 838 | 860 | 872 | 883 | 906 |
| 9 | 920 | 950 | 980 | 1011 | 1041 | 1071 | 1101 | 1131 | 1162 | 1177 | 1192 | 1222 |
| 10 | 1149 | 1186 | 1224 | 1261 | 1298 | 1335 | 1373 | 1410 | 1447 | 1466 | 1484 | 1522 |
| 11 | 1361 | 1405 | 1449 | 1493 | 1536 | 1580 | 1624 | 1667 | 1711 | 1733 | 1755 | 1798 |
| 12 | 1493 | 1541 | 1588 | 1636 | 1684 | 1732 | 1780 | 1827 | 1875 | 1899 | 1923 | 1971 |
| 13 | 1575 | 1625 | 1676 | 1726 | 1776 | 1826 | 1876 | 1926 | 1976 | 2001 | 2026 | 2075 |
| 14 | 1818 | 1873 | 1927 | 1980 | 2033 | 2084 | 2135 | 2185 | 2234 | 2259 | 2283 | 2330 |
| 15 | 2265 | 2314 | 2361 | 2404 | 2446 | 2485 | 2522 | 2558 | 2590 | 2607 | 2623 | 2653 |
| 16 | 2697 | 2724 | 2749 | 2770 | 2790 | 2807 | 2823 | 2838 | 2851 | 2858 | 2864 | 2875 |
| 17 | 2918 | 2927 | 2935 | 2941 | 2947 | 2952 | 2956 | 2960 | 2963 | 2964 | 2966 | 2968 |
| 18 | 2984 | 2986 | 2988 | 2989 | 2990 | 2991 | 2992 | 2993 | 2993 | 2993 | 2994 | 2994 |
| 19 | 2998 | 2998 | 2998 | 2998 | 2999 | 2999 | 2999 | 2999 | 2999 | 2999 | 2999 | 2999 |
| 20 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 21 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 22 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 23 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 24 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 25 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |

Wind speed as 10 minute average value at hub height and perpendicular to the rotor plane.

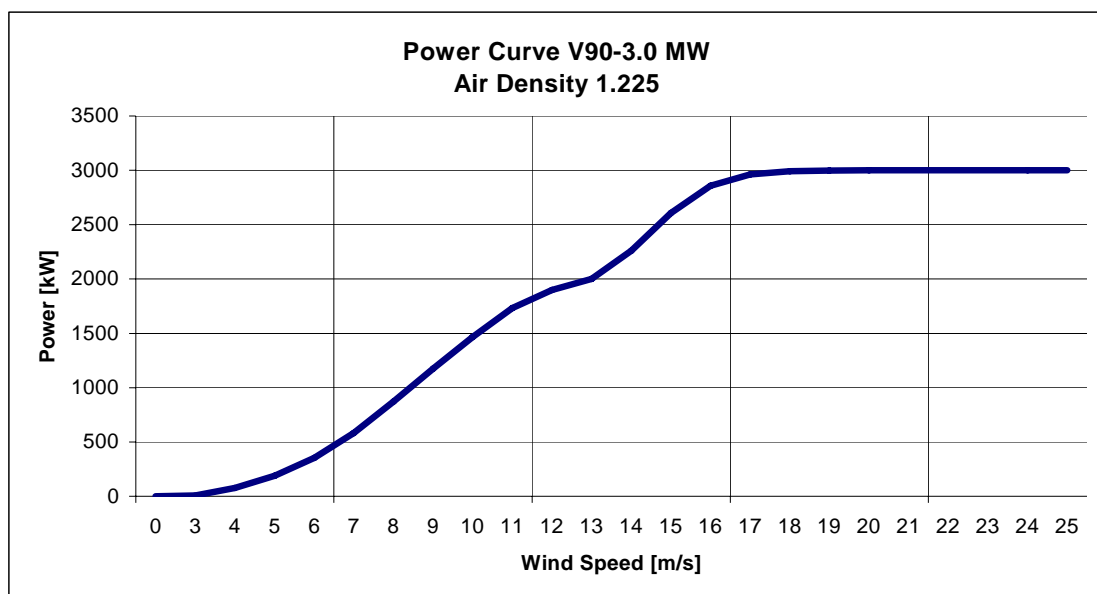


Figure 5 Power curve for Vestas V90 - 3.0 MW, 50 Hz, Mode 3 - 104.4 dB(A).

2.1.5 Power Curve, Mode 4 - 102.8 dB(A)

| V90 - 3.0 MW, 50 Hz, Mode 4 - 102.8 dB(A) | | | | | | | | | | | | |
|---|----------------------------------|------|------|------|------|------|------|------|------|-------|------|------|
| Wind Speed [m/s] | Air Density [kg/m ³] | | | | | | | | | | | |
| | 0.97 | 1 | 1.03 | 1.06 | 1.09 | 1.12 | 1.15 | 1.18 | 1.21 | 1.225 | 1.24 | 1.27 |
| 4 | 53 | 56 | 58 | 61 | 64 | 67 | 70 | 72 | 75 | 77 | 78 | 81 |
| 5 | 142 | 148 | 153 | 159 | 165 | 170 | 176 | 181 | 187 | 190 | 193 | 198 |
| 6 | 271 | 281 | 290 | 300 | 310 | 319 | 329 | 339 | 348 | 353 | 358 | 368 |
| 7 | 449 | 464 | 479 | 495 | 510 | 525 | 540 | 555 | 571 | 578 | 586 | 601 |
| 8 | 656 | 677 | 699 | 721 | 742 | 764 | 786 | 807 | 829 | 840 | 851 | 873 |
| 9 | 856 | 884 | 912 | 940 | 968 | 996 | 1024 | 1052 | 1080 | 1094 | 1108 | 1137 |
| 10 | 1047 | 1081 | 1115 | 1149 | 1183 | 1217 | 1251 | 1285 | 1319 | 1336 | 1353 | 1387 |
| 11 | 1231 | 1271 | 1311 | 1350 | 1390 | 1430 | 1469 | 1509 | 1549 | 1568 | 1588 | 1628 |
| 12 | 1391 | 1436 | 1480 | 1525 | 1569 | 1614 | 1658 | 1703 | 1748 | 1770 | 1792 | 1837 |
| 13 | 1503 | 1551 | 1599 | 1647 | 1695 | 1743 | 1791 | 1839 | 1887 | 1911 | 1935 | 1983 |
| 14 | 1544 | 1593 | 1642 | 1691 | 1740 | 1789 | 1838 | 1886 | 1935 | 1960 | 1984 | 2033 |
| 15 | 1647 | 1695 | 1742 | 1789 | 1835 | 1881 | 1926 | 1971 | 2016 | 2038 | 2061 | 2104 |
| 16 | 2064 | 2104 | 2141 | 2179 | 2213 | 2248 | 2281 | 2313 | 2345 | 2361 | 2376 | 2406 |
| 17 | 2579 | 2601 | 2621 | 2641 | 2658 | 2675 | 2691 | 2706 | 2721 | 2728 | 2736 | 2748 |
| 18 | 2874 | 2882 | 2889 | 2896 | 2901 | 2907 | 2912 | 2916 | 2921 | 2923 | 2925 | 2929 |
| 19 | 2973 | 2975 | 2976 | 2978 | 2979 | 2980 | 2982 | 2983 | 2984 | 2984 | 2984 | 2985 |
| 20 | 2995 | 2996 | 2996 | 2996 | 2997 | 2997 | 2997 | 2997 | 2997 | 2997 | 2997 | 2998 |
| 21 | 2999 | 2999 | 2999 | 2999 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 22 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 23 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 24 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |
| 25 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 | 3000 |

Wind speed as 10 minute average value at hub height and perpendicular to the rotor plane.

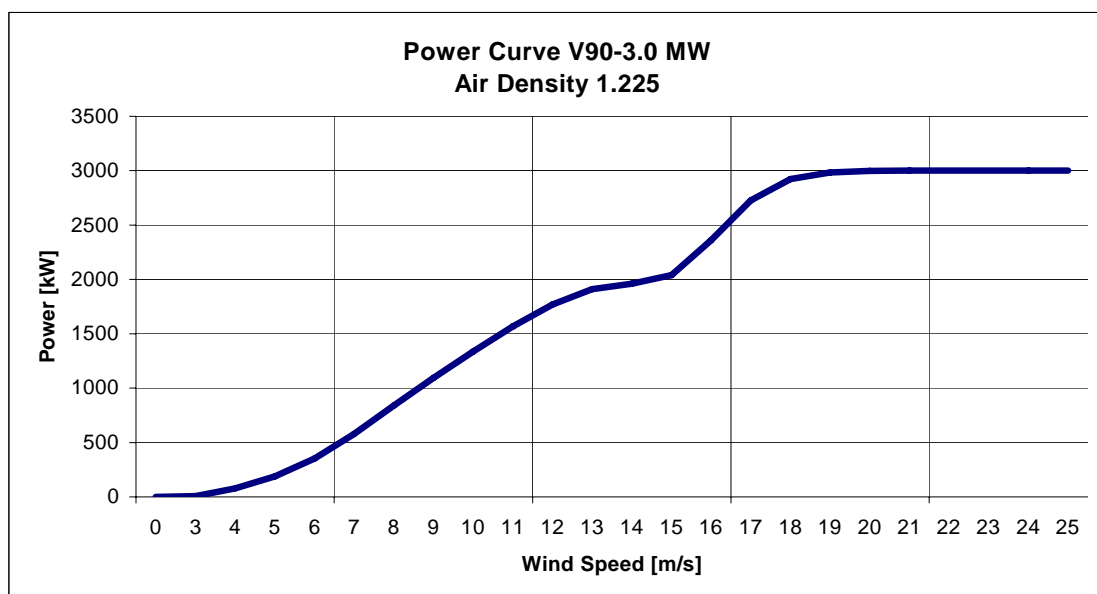


Figure 6 Power curve for Vestas V90 - 3.0 MW, 50 Hz, Mode 4 - 102.8 dB(A).

2.2 Annual Production V90 - 3.0MW

Below the annual outputs for different wind distributions are listed. All calculations are based on:

Wind conditions with 10% turbulence and an air density of 1.225 kg/m³
 80m tower
 100% availability.

| C=1.5 | | | | | | |
|--------------|--------------|--------------|--------------|--------------|--------------|---------------|
| Wind Turbine | 5 m/s | 6 m/s | 7 m/s | 8 m/s | 9 m/s | 10 m/s |
| | MWh | MWh | MWh | MWh | MWh | MWh |
| Mode 0 | 3997 | 5882 | 7695 | 9300 | 10627 | 11660 |
| Mode 1 | 3972 | 5842 | 7644 | 9240 | 10563 | 11594 |
| Mode 2 | 3892 | 5718 | 7485 | 9057 | 10365 | 11390 |
| Mode 3 | 3554 | 5162 | 6741 | 8174 | 9391 | 10363 |
| Mode 4 | 3340 | 4807 | 6252 | 7576 | 8713 | 9631 |

| C=2.0 | | | | | | |
|--------------|--------------|--------------|--------------|--------------|--------------|---------------|
| Wind Turbine | 5 m/s | 6 m/s | 7 m/s | 8 m/s | 9 m/s | 10 m/s |
| | MWh | MWh | MWh | MWh | MWh | MWh |
| Mode 0 | 3277 | 5338 | 7553 | 9706 | 11650 | 13298 |
| Mode1 | 3262 | 5302 | 7497 | 9633 | 11567 | 13210 |
| Mode 2 | 3214 | 5191 | 7321 | 9408 | 11312 | 12941 |
| Mode 3 | 3027 | 4737 | 6559 | 8377 | 10092 | 11610 |
| Mode 4 | 2897 | 4458 | 6095 | 7730 | 9290 | 10699 |

| C=2.5 | | | | | | |
|--------------|--------------|--------------|--------------|--------------|--------------|---------------|
| Wind Turbine | 5 m/s | 6 m/s | 7 m/s | 8 m/s | 9 m/s | 10 m/s |
| | MWh | MWh | MWh | MWh | MWh | MWh |
| Mode 0 | 2768 | 4798 | 7184 | 9654 | 11987 | 14058 |
| Mode 1 | 2763 | 4774 | 7131 | 9573 | 11888 | 13951 |
| Mode 2 | 2742 | 4694 | 6965 | 9326 | 11586 | 13622 |
| Mode 3 | 2660 | 4394 | 6305 | 8267 | 10201 | 12031 |
| Mode 4 | 2583 | 4187 | 5912 | 7651 | 9359 | 11004 |

2.3 Noise Curves V90 - 3.0 MW

2.3.1 Noise Curve V90 - 3.0 MW, 50 Hz, Mode 0 - 109.4 dB (A)

| Guaranteed Sound Power Level at Hub Height: Noise mode 0 | | | | |
|---|--|------------|------------|-------------|
| Conditions for Sound Power Level: | Measurement standard IEC 61400-11 ed. 2 2002 Wind shear: 0.16 Max. turbulence at 10 meter height: 16% Inflow angle (vertical): $0 \pm 2^\circ$ Air density: 1.225 kg/m^3 | | | |
| Hub Height | 65m | 80m | 90m | 105m |
| L_{WA} @ 4 m/s (10 m above ground) [dBA] | 96.4 | 97.0 | 97.5 | 98.2 |
| Wind speed at hh [m/sec] | 5.4 | 5.6 | 5.7 | 5.8 |
| L_{WA} @ 5 m/s (10 m above ground) [dBA] | 101.5 | 102 | 102.4 | 103.0 |
| Wind speed at hh [m/sec] | 6.8 | 7.0 | 7.1 | 7.3 |
| L_{WA} @ 6 m/s (10 m above ground) [dBA] | 105.3 | 105.8 | 106.1 | 106.5 |
| Wind speed at hh [m/sec] | 8.1 | 8.4 | 8.5 | 8.7 |
| L_{WA} @ 7 m/s (10 m above ground) [dBA] | 107.8 | 108.2 | 108.3 | 108.6 |
| Wind speed at hh [m/sec] | 9.4 | 9.8 | 9.9 | 10.2 |
| L_{WA} @ 8 m/s (10 m above ground) [dBA] | 109.1 | 109.3 | 109.4 | 109.4 |
| Wind speed at hh [m/sec] | 10.8 | 11.2 | 11.4 | 11.7 |
| L_{WA} @ 9 m/s (10 m above ground) [dBA] | 109.4 | 109.4 | 109.2 | 109.0 |
| Wind speed at hh [m/sec] | 12.1 | 12.6 | 12.8 | 13.1 |
| L_{WA} @ 10 m/s (10 m above ground) [dBA] | 108.0 | 106.7 | 106.5 | 106.3 |
| Wind speed at hh [m/sec] | 13.5 | 14.0 | 14.3 | 14.6 |
| L_{WA} @ 11 m/s (10 m above ground) [dBA] | 106.1 | 105.9 | 105.9 | 105.8 |
| Wind speed at hh [m/sec] | 14.8 | 15.3 | 15.6 | 16.0 |
| L_{WA} @ 12 m/s (10 m above ground) [dBA] | 105.8 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 16.2 | 16.7 | 17.1 | 17.5 |
| L_{WA} @ 13 m/s (10 m above ground) [dBA] | 105.6 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 17.5 | 18.1 | 18.5 | 18.9 |

The noise level is guaranteed for the turbine configuration as described in the general specification.

The noise guarantee will be regarded as fulfilled, if a measured sound power level minus the inaccuracy of the measurement result is lower than the guaranteed value.

2.3.2 Noise Curve V90 - 3.0 MW, 50 Hz, Mode 1 - 107.8 dB (A)

| Guaranteed Sound Power Level at Hub Height: Noise mode 1 | | | | |
|---|--|------------|------------|-------------|
| Conditions for Sound Power Level: | Measurement standard IEC 61400-11 ed. 2 2002 Wind shear: 0.16 Max. turbulence at 10 meter height: 16% Inflow angle (vertical): $0 \pm 2^\circ$ Air density: 1.225 kg/m^3 | | | |
| Hub Height | 65m | 80m | 90m | 105m |
| L_{WA} @ 4 m/s (10 m above ground) [dBA] | 96.4 | 97.0 | 97.5 | 98.2 |
| Wind speed at hh [m/sec] | 5.4 | 5.6 | 5.7 | 5.8 |
| L_{WA} @ 5 m/s (10 m above ground) [dBA] | 101.5 | 102 | 102.4 | 103.0 |
| Wind speed at hh [m/sec] | 6.8 | 7.0 | 7.1 | 7.3 |
| L_{WA} @ 6 m/s (10 m above ground) [dBA] | 105.3 | 105.8 | 106.1 | 106.5 |
| Wind speed at hh [m/sec] | 8.1 | 8.4 | 8.5 | 8.7 |
| L_{WA} @ 7 m/s (10 m above ground) [dBA] | 107.5 | 107.7 | 107.8 | 107.8 |
| Wind speed at hh [m/sec] | 9.4 | 9.8 | 9.9 | 10.2 |
| L_{WA} @ 8 m/s (10 m above ground) [dBA] | 107.8 | 107.8 | 107.8 | 107.8 |
| Wind speed at hh [m/sec] | 10.8 | 11.2 | 11.4 | 11.7 |
| L_{WA} @ 9 m/s (10 m above ground) [dBA] | 107.8 | 107.8 | 107.8 | 107.7 |
| Wind speed at hh [m/sec] | 12.1 | 12.6 | 12.8 | 13.1 |
| L_{WA} @ 10 m/s (10 m above ground) [dBA] | 107.2 | 106.7 | 106.5 | 106.3 |
| Wind speed at hh [m/sec] | 13.5 | 14.0 | 14.3 | 14.6 |
| L_{WA} @ 11 m/s (10 m above ground) [dBA] | 106.1 | 105.9 | 105.9 | 105.8 |
| Wind speed at hh [m/sec] | 14.8 | 15.3 | 15.6 | 16.0 |
| L_{WA} @ 12 m/s (10 m above ground) [dBA] | 105.8 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 16.2 | 16.7 | 17.1 | 17.5 |
| L_{WA} @ 13 m/s (10 m above ground) [dBA] | 105.6 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 17.5 | 18.1 | 18.5 | 18.9 |

The noise level is guaranteed for the turbine configuration as described in the general specification.

The noise guarantee will be regarded as fulfilled, if a measured sound power level minus the inaccuracy of the measurement result is lower than the guaranteed value.

2.3.3 Noise Curve V90 - 3.0 MW, 50 Hz, Mode 2 - 106.8 dB (A)

| Guaranteed Sound Power Level at Hub Height: Noise mode 2 | | | | |
|---|--|------------|------------|-------------|
| Conditions for Sound Power Level: | Measurement standard IEC 61400-11 ed. 2 2002 Wind shear: 0.16 Max. turbulence at 10 meter height: 16% Inflow angle (vertical): $0 \pm 2^\circ$ Air density: 1.225 kg/m^3 | | | |
| Hub Height | 65m | 80m | 90m | 105m |
| L_{WA} @ 4 m/s (10 m above ground) [dBA] | 96.4 | 97.0 | 97.5 | 98.2 |
| Wind speed at hh [m/sec] | 5.4 | 5.6 | 5.7 | 5.8 |
| L_{WA} @ 5 m/s (10 m above ground) [dBA] | 101.5 | 102 | 102.4 | 103.0 |
| Wind speed at hh [m/sec] | 6.8 | 7.0 | 7.1 | 7.3 |
| L_{WA} @ 6 m/s (10 m above ground) [dBA] | 105.2 | 105.6 | 105.8 | 106.3 |
| Wind speed at hh [m/sec] | 8.1 | 8.4 | 8.5 | 8.7 |
| L_{WA} @ 7 m/s (10 m above ground) [dBA] | 106.8 | 106.8 | 106.8 | 106.8 |
| Wind speed at hh [m/sec] | 9.4 | 9.8 | 9.9 | 10.2 |
| L_{WA} @ 8 m/s (10 m above ground) [dBA] | 106.8 | 106.8 | 106.8 | 106.8 |
| Wind speed at hh [m/sec] | 10.8 | 11.2 | 11.4 | 11.7 |
| L_{WA} @ 9 m/s (10 m above ground) [dBA] | 106.8 | 106.8 | 106.8 | 106.8 |
| Wind speed at hh [m/sec] | 12.1 | 12.6 | 12.8 | 13.1 |
| L_{WA} @ 10 m/s (10 m above ground) [dBA] | 106.8 | 106.8 | 106.5 | 106.3 |
| Wind speed at hh [m/sec] | 13.5 | 14.0 | 14.3 | 14.6 |
| L_{WA} @ 11 m/s (10 m above ground) [dBA] | 106.1 | 105.9 | 105.9 | 105.8 |
| Wind speed at hh [m/sec] | 14.8 | 15.3 | 15.6 | 16.0 |
| L_{WA} @ 12 m/s (10 m above ground) [dBA] | 105.8 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 16.2 | 16.7 | 17.1 | 17.5 |
| L_{WA} @ 13 m/s (10 m above ground) [dBA] | 105.6 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 17.5 | 18.1 | 18.5 | 18.9 |

The noise level is guaranteed for the turbine configuration as described in the general specification.

The noise guarantee will be regarded as fulfilled, if a measured sound power level minus the inaccuracy of the measurement result is lower than the guaranteed value.

2.3.4 Noise Curve V90 - 3.0 MW, 50 Hz, Mode 3 - 104.4 dB (A)

| Guaranteed Sound Power Level at Hub Height: Noise mode 3 | | | | |
|---|--|------------|------------|-------------|
| Conditions for Sound Power Level: | Measurement standard IEC 61400-11 ed. 2 2002 Wind shear: 0.16 Max. turbulence at 10 meter height: 16% Inflow angle (vertical): $0 \pm 2^\circ$ Air density: 1.225 kg/m^3 | | | |
| Hub Height | 65m | 80m | 90m | 105m |
| L_{WA} @ 4 m/s (10 m above ground) [dBA] | 96.4 | 97.0 | 97.5 | 98.2 |
| Wind speed at hh [m/sec] | 5.4 | 5.6 | 5.7 | 5.8 |
| L_{WA} @ 5 m/s (10 m above ground) [dBA] | 101.5 | 102.0 | 102.4 | 102.9 |
| Wind speed at hh [m/sec] | 6.8 | 7.0 | 7.1 | 7.3 |
| L_{WA} @ 6 m/s (10 m above ground) [dBA] | 104.4 | 104.4 | 104.4 | 104.4 |
| Wind speed at hh [m/sec] | 8.1 | 8.4 | 8.5 | 8.7 |
| L_{WA} @ 7 m/s (10 m above ground) [dBA] | 104.4 | 104.4 | 104.4 | 104.4 |
| Wind speed at hh [m/sec] | 9.4 | 9.8 | 9.9 | 10.2 |
| L_{WA} @ 8 m/s (10 m above ground) [dBA] | 104.4 | 104.4 | 104.4 | 104.4 |
| Wind speed at hh [m/sec] | 10.8 | 11.2 | 11.4 | 11.7 |
| L_{WA} @ 9 m/s (10 m above ground) [dBA] | 104.4 | 104.0 | 104.4 | 104.4 |
| Wind speed at hh [m/sec] | 12.1 | 12.6 | 12.8 | 13.1 |
| L_{WA} @ 10 m/s (10 m above ground) [dBA] | 104.4 | 104.1 | 104.4 | 104.4 |
| Wind speed at hh [m/sec] | 13.5 | 14.0 | 14.3 | 14.6 |
| L_{WA} @ 11 m/s (10 m above ground) [dBA] | 104.4 | 104.9 | 105.2 | 105.8 |
| Wind speed at hh [m/sec] | 14.8 | 15.3 | 15.6 | 16.0 |
| L_{WA} @ 12 m/s (10 m above ground) [dBA] | 105.8 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 16.2 | 16.7 | 17.1 | 17.5 |
| L_{WA} @ 13 m/s (10 m above ground) [dBA] | 105.6 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 17.5 | 18.1 | 18.5 | 18.9 |

The noise level is guaranteed for the turbine configuration as described in the general specification.

The noise guarantee will be regarded as fulfilled, if a measured sound power level minus the inaccuracy of the measurement result is lower than the guaranteed value.

2.3.5 Noise Curve V90 - 3.0 MW, 50 Hz, Mode 4 - 102.8 dB (A)

| Guaranteed Sound Power Level at Hub Height: Noise mode 4 | | | | |
|---|--|------------|------------|-------------|
| Conditions for Sound Power Level: | Measurement standard IEC 61400-11 ed. 2 2002 Wind shear: 0.16 Max. turbulence at 10 meter height: 16% Inflow angle (vertical): $0 \pm 2^\circ$ Air density: 1.225 kg/m^3 | | | |
| Hub Height | 65m | 80m | 90m | 105m |
| L_{WA} @ 4 m/s (10 m above ground) [dBA] | 96.4 | 97.0 | 97.5 | 98.2 |
| Wind speed at hh [m/sec] | 5.4 | 5.6 | 5.7 | 5.8 |
| L_{WA} @ 5 m/s (10 m above ground) [dBA] | 101.5 | 102.0 | 102.2 | 102.4 |
| Wind speed at hh [m/sec] | 6.8 | 7.0 | 7.1 | 7.3 |
| L_{WA} @ 6 m/s (10 m above ground) [dBA] | 102.8 | 102.8 | 102.8 | 102.8 |
| Wind speed at hh [m/sec] | 8.1 | 8.4 | 8.5 | 8.7 |
| L_{WA} @ 7 m/s (10 m above ground) [dBA] | 102.8 | 102.8 | 102.8 | 102.8 |
| Wind speed at hh [m/sec] | 9.4 | 9.8 | 9.9 | 10.2 |
| L_{WA} @ 8 m/s (10 m above ground) [dBA] | 102.8 | 102.8 | 102.8 | 102.8 |
| Wind speed at hh [m/sec] | 10.8 | 11.2 | 11.4 | 11.7 |
| L_{WA} @ 9 m/s (10 m above ground) [dBA] | 102.8 | 102.8 | 102.8 | 102.8 |
| Wind speed at hh [m/sec] | 12.1 | 12.6 | 12.8 | 13.1 |
| L_{WA} @ 10 m/s (10 m above ground) [dBA] | 102.8 | 102.8 | 102.8 | 102.8 |
| Wind speed at hh [m/sec] | 13.5 | 14.0 | 14.3 | 14.6 |
| L_{WA} @ 11 m/s (10 m above ground) [dBA] | 102.8 | 102.8 | 102.9 | 103.6 |
| Wind speed at hh [m/sec] | 14.8 | 15.3 | 15.6 | 16.0 |
| L_{WA} @ 12 m/s (10 m above ground) [dBA] | 103.9 | 105.0 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 16.2 | 16.7 | 17.1 | 17.5 |
| L_{WA} @ 13 m/s (10 m above ground) [dBA] | 105.6 | 105.7 | 105.7 | 105.7 |
| Wind speed at hh [m/sec] | 17.5 | 18.1 | 18.5 | 18.9 |

The noise level is guaranteed for the turbine configuration as described in the general specification.

The noise guarantee will be regarded as fulfilled, if a measured sound power level minus the inaccuracy of the measurement result is lower than the guaranteed value.

3. Micro Siting and Network Connection

3.1 Siting in Wind Farms

Often wind turbines are placed in wind farms where park turbulence must be taken into account.

If the wind conditions of section 4.2 and a uniform wind rose apply, the wind turbines can be sited in a wind farm with a distance of at least 5 rotor diameters (450 m) between the wind turbines.

If the wind turbines are placed in one row in a site with the wind conditions of section 4.2 and a uniform wind rose, the distance between the wind turbines should be at least 4 rotor diameters (360 m).

With the above in mind, it is recommended that Vestas participates in the micro siting evaluation of the wind turbines.

3.2 Terrain Conditions

If the terrain does not live up to the specifications listed below or if the terrain otherwise seems complex, particular considerations may be necessary and Vestas must be contacted.

- Within a radius of 100 meters from the turbine, max. slope of 10°.
- Within a radius of 100 to 500 meters from the turbine, max. slope of 15°.
- Within a radius of 500 to 2000 meters from the turbine, max. slope of 20°.

3.3 Connection to the Electrical Power Grid

The transformer in the nacelle is manufactured to meet the nominal voltage of the interconnection grid (see section 7.7 for acceptable grid voltage range without further transformation). The voltage of the high voltage grid must be within +5/-5% of nominal voltage. Steady variations within +1/-3 Hz (50 Hz) are acceptable. Intermittent or rapid grid frequency fluctuations may cause serious damage to the turbine. Averaged over the wind turbine's lifetime, grid failure must not occur more than once a week (e.g. a maximum of 52 occurrences within a year).

A ground connection of maximum 10 Ω must be present.

The customer's earthing system must be designed for local soil conditions. The resistance to neutral earth must be in accordance with the requirements of the local authorities.

NB: When ordering, please provide VESTAS with precise information about grid voltage in order to facilitate specification of the transformer's nominal voltage and winding connection (delta connection on the high voltage winding is supplied as default, unless otherwise specified). As an option, VESTAS offers a high voltage switchgear.

4. General Ambient Design Criteria

4.1 General Conditions

The wind turbine is designed for operation in ambient temperatures ranging from -20°C to +40°C. All components including liquids, oil etc. are designed to survive temperatures as low as -40°C. Special precautions must be taken outside these temperatures. If the temperature inside the nacelle exceeds 50°C, the turbine is paused.

The relative humidity can be 100% (max. 10% of the lifetime). Corrosion protection is according to ISO 12944-2 or corrosion class C5M (outside) and C3 to C4 (inside). All corrosion protections are designed for long lifetime (more than 15 years). See special differentiation on the tower in section 7.17 Tower.

4.2 Wind Conditions

The wind conditions can be described by a Weibull distribution where the annual average wind speed and a shape parameter (C) describe the wind distribution. Furthermore, the wind climate can be described by maximum wind speeds and the turbulence. Turbulence is a factor describing short-term wind variations/fluctuations. Below, the design conditions assumed for the operating environment for the Vestas V90-3.0 MW 50 Hz wind turbine are listed.

- Standard IEC IA
- Average wind speed 10.0 m/s
- C-parameter 2
- Turbulence I₁₅*) 18%
- Max. average wind **) 50.0 m/s
- Max. wind gust ***) 70.0 m/s

*) The turbulence is wind dependent and varies from 34.1 - 16.1% at wind speeds between 4 - 25 m/s. At 15 m/s the turbulence is 18%.

**) 10 min, 50 years' mean wind speed.

***) 3 sec, 50 years' gust wind speed.

Wind speed and turbulence refer to hub height.

The wind conditions listed above are design parameters as is the cut out wind speed. Other parameters can also influence the turbine lifetime and the following values should not be exceeded.

- Cut out wind speed 25 m/s
- Restart wind speed 20 m/s

5. Type Approvals

The V90 - 3.0 MW wind turbine is type approved in accordance with:

- IEC WT01
- DS472
- NVN 11400-0
- DIBt Richtlinie für Windkraftanlagen

6. Options

6.1 Advanced Grid Option 2

Wind turbines with the advanced grid option are specially designed to tolerate short time voltage reductions due to grid faults. With the grid option the turbines generate a capacitive short circuit current, improve the grid stability and resume power production almost instantly after a grid fault.

The turbine is equipped with a reinforced Vestas Converter System in order to gain better control of the generator during grid faults. The controllers and contactors have a UPS backup system in order to keep the turbine control system running during grid faults.

The pitch system is optimized to keep the turbine within normal speed conditions and the generator is accelerated in order to store rotational energy and be able to resume normal power production after a fault.

6.2 Extended UPS

The UPS system consists of one UPS from which the power is distributed to a number of strings. Some of these strings have a timer controlled relay function which disconnects the power to the devices on the string. The control for the timer is managed by the turbine control system and some preset timers. The reason for disconnecting some strings is different demands on the length of backup time needed for the different devices. Disconnecting some strings allows the remaining strings to run for a longer time without draining the battery too fast, which would close down the UPS and no power would be available.

When the grid supply is present, the power flows through the UPS and it uses the grid supply to charge the batteries. When the grid supply is not present, the UPS takes the power from the batteries and supplies all components connected to the UPS.

The UPS system is designed as a basic system to which a number of options can be added. It is also designed as a modular system thus enabling UPS output and backup time to be changed without a major redesign.

6.3 High Voltage Switchgear

The high voltage SF₆ fully insulated switchgear consists of two separate cubicles. The two cubicles are a feeder panel with a load breaker switch and a circuit breaker. The load breaker switch has 3 positions: closed, open and earthed. When the breaker is in earthed position, the grid cable is connected to earth. The circuit breaker cubicle contains a load breaker switch and a circuit breaker with a self-powered relay. The load breaker is also a 3-positioned breaker, which can earth the transformer cable through the circuit breaker. The relay provides the opportunity of tripping the circuit breaker externally (230 V) either by the VMP controller, arc detector, smoke detector or manually from the nacelle.

The purpose of the switchgear is to protect the turbine against over current, short-circuit and earth faults.

Both cubicles can be equipped with capacitive voltage indicators, motorisation and tank manometers.

The cable connection on the switchgear is standard 630 A elbow cone connectors. Loop in and out option is available.

6.4 Obstruction Light

Vestas is capable of delivering optional obstruction lighting for the V90 3MW turbine. The turbine will be equipped with 2 obstruction lights on the nacelle, placed in such a manner that at least one light will always be visible.

The following standard integrated aviation light options are available:

1. Low intensity. Red 10-200 cd.
2. Medium intensity. Red/white/dual 200-2000 cd.
3. Medium intensity. Red/white/dual 2000-20000 cd.

The options are designed according to the ICAO and the FAA codes.

When using obstruction light delivered by Vestas, a range of additional features are offered: Remote monitoring of light function, supervision of remaining lifetime, alarm if a lamp failure occurs and intensity control according to weather visibility.

When installed in a wind farm, the obstruction light flashes can be synchronised throughout the whole wind farm.

6.5 Service Lift inside the Tower

The turbine can be delivered with a service lift inside the tower.

6.6 Wind Turbine Colour

Default colour Ral 7035 (light grey) and optional Ral 9010 (white) are available.

7. Technical Specifications and Diagrams

7.1 Rotor

| | |
|---------------------------------|------------------------|
| Diameter: | 90 m |
| Swept area: | 6362 m ² |
| Rotational speed static, rotor: | 16.1 RPM |
| Speed, dynamic operation range: | 8.6 - 18.4 RPM |
| Rotational direction: | Clockwise (front view) |
| Orientation: | Upwind |
| Tilt: | 6° |
| Blade coning: | 4° |
| Number of blades: | 3 |
| Aerodynamic brakes: | Full feathering |

7.2 Hub

| | |
|-----------|----------------|
| Type: | SG Cast Iron |
| Material: | GJS-400-18U-LT |
| Weight: | 8000 kg |

7.3 Blades

| | |
|-------------------------------|--|
| Principle: | Airfoil shells bonded to supporting spar |
| Material: | Fibreglass and carbon fibre reinforced epoxy |
| Blade connection: | Steel root inserts |
| Air foils: | RISØ P + FFA-W3 |
| Length: | 44 m |
| Chord at blade root: | 3.512 m |
| Chord at blade tip: | 0.391 m |
| Twist (blade root/blade tip): | 17.5° |

7.4 Bearings

| | |
|-------|----------------------|
| Type: | 4-point ball bearing |
|-------|----------------------|

7.5 Sensors

7.5.1 Lightning Detector

| | |
|--------------|--------------------|
| Appellation: | Lightning detector |
| Signal: | Optical analogue |

7.5.2 Wind Sensor

| | |
|--------------|---|
| Appellation: | Acoustic resonance (2 units) |
| Signal: | RS485 |
| Accuracy: | +/- 0.5 m/s, less than 15 m/s +/- 4%, more than 15 m/s |

7.5.3 Smoke Detector

Appellation: Smoke detector
Signal: Digital 24 V

7.5.4 Movements and Vibrations

Appellation: Accelerometer, tower
Signal: RS485

7.6 Generator

Rated power: 3.0 MW
Type: Asynchronous with wound rotor,
slip rings and VCS
Voltage: 1000 VAC
Frequency: 50 Hz
No. of poles: 4
Protection class: IP54
Rated speed: 1680
Rated power factor,
default at 1000 V: 1.0
Power factor range at
1000 V: 0.98_{CAP} - 0.96_{IND}

7.7 Transformer

Type: Cast resin
Rated power: 3140 kVA
High voltage: 10 – 33,0 kV
Frequency: 50 Hz
Vector group: Dyn
HV - Tappings: $\pm 2 \times 2.5\%$

Low voltage: 1000 V
Power at 1000 V: 2835 kVA

Low voltage: 400 V
Power at 400 V: 305 kVA

7.8 Switchgear, Electrical Characteristics

7.8.1 Feeder Function

| | | |
|--|---------|---------|
| Rated voltage [kV] (Max. system voltage) | 24 | 36 |
| Rated current [A] | 400/630 | 400/630 |
| Short time withstand current (1 or 3 s) [kA] | 16/20 | 16/20 |
| Insulation level: | | |
| Power frequency (1 min) [kV] | 50 | 70 |
| Lightning impulse [kV _{peak}] | 125 | 170 |
| Making capacity [kA _{peak}] | 40/50 | 40/50 |
| Breaking capacity: | | |
| Mainly active current [A] | 400/630 | 400/630 |
| Capacitive current [A] | 31.5 | 31.5 |
| Inductive current [A] | 16 | 16 |

7.8.2 Circuit Breaker Function

| | | |
|--|------------|------------|
| Rated voltage [kV] (Max. system voltage) | 24 | 36 |
| Rated current [A] | 400/630 | 400/630 |
| Short time withstand current (1 or 3 s) [kA] | 12.5/16/20 | 12.5/16/20 |
| Insulation level: | | |
| Power frequency (1 min) [kV] | 50 | 70 |
| Lightning impulse [kV _{peak}] | 125 | 170 |
| Making capacity [kA _{peak}] | 31/40/50 | 31/40/50 |
| Breaking capacity [kA] | 12.5/16/20 | 12.5/16/20 |

7.9 Yaw System

Type: Plain bearing system with built-in friction
 Material: Forged yaw ring, heat-treated. Plain bearings PETP
 Yawing speed: <0.5°/sec

7.10 Yaw Gears

Type: 4-step planetary gear with motor brake
 Motor: 2.2 kW, 4-pole, asynchronous

7.11 Gearbox

Type: 2 planetary stages + 1 helical stage
Type no.: EF901
Shaft distance: 461 mm
Ratio: 1:104.5 (50 Hz)

7.12 Parking Brake

Type: PZ.I.4420.2802.10
Brake pad type: MPM 030
Supply: Separate hydraulic pump unit

7.13 Hydraulics

Pressure: 260 bar
Location: The hydraulic power unit is located in the nacelle.
A pipe connects the hydraulic power unit in the nacelle with a manifold for the pitch system in the hub.

7.14 Cooling System

Gear oil cooling: 2 water/air cooling units located above the transformer room. Connected to the oil/water heat exchanger located by the gear oil tank.

Generator cooling: 2 water/air coolers located above the transformer room.

Water cooling: Coupled on generator cooler.

Transformer cooling: Cooling air is blown through the windings from the bottom of the transformer.

Nacelle cooling: Cooling of the nacelle is done by leading air through an opening in the fibreglass floor behind the tower. Outgoing air is led through a fan to the transformer room and blown out at the rear end of the nacelle. The air intake and outlet are controlled by flap valves, which open when the nacelle temperature reaches a certain level.

7.15 Nacelle Bedplate

Front part: Spheroidal graphite iron GJS-400-18U-LT
Foundation for gear, generator, yaw bedding, crane girders and rear foundation.

Weight: 8500 kg

Rear part: Welded gratings integrated with crane girders.
Foundation for electrical panels, transformer and cooling room.

7.16 Nacelle

Material: Fibreglass.

7.17 Tower

| | |
|--|--------------------------------|
| Type: | Conical tubular |
| Material: | S355 J2G3/NL |
| Surface treatment: | Painted |
| Corrosion class, outside: | C4 (ISO 12944-2)/offshore C5-M |
| Corrosion class, inside: | C3 (ISO 12944-2)/offshore C4 |
| Top diameter for all towers: | 2.3 m |
| Bottom diameter for all towers: | 4.15 m |
| Hub height: | |
| 3-parted, modular tower (IEC I / DiBT III) | 80 m |
| 5-parted, modular tower (105 m DiBt II) | 105 m |

The exact hub heights listed include a distance from the foundation section to the ground level of 0.55 m and a distance from the tower top flange to the centre of the hub of 1.95 m.

7.18 Weight and Dimensions

7.18.1 Nacelle

Including hub and nose cone:

| | |
|-------------|----------------------|
| Length: | 13.25 m |
| Width: | 3.6 m |
| Height: | 4.05 m |
| Weight app. | 91000 kg +/- 3000 kg |

Without hub and nose cone:

| | |
|--------------|----------------------|
| Length: | 9.65 m |
| Width: | 3.6 m |
| Height: | 4.05 m |
| Weight app.: | 70000 kg +/- 2000 kg |

7.18.2 Gearbox

| | |
|-------------|----------|
| Length: | 2100 mm |
| Diameter: | 2600 mm |
| Max weight: | 23000 kg |

7.18.3 Generator

| | |
|---------------|---------|
| Max length: | 2800 mm |
| Max diameter: | 1100 mm |
| Max weight: | 8600 kg |

7.18.4 Transformer

| | |
|-------------|---------|
| Length: | 2340 mm |
| Width: | 1090 mm |
| Height: | 2150 mm |
| Max weight: | 8000 kg |

7.18.5 Rotor Blades

| | |
|-------------|-------------------------|
| Length: | 44 m |
| Max weight: | 6600 kg/pcs. +/- 400 kg |

7.18.6 Switchgear, Feeder Function (Option)

| | | |
|--------------------|------|------|
| Rated voltage [kV] | 24 | 36 |
| Width [mm] | 370 | 420 |
| Height [mm] | 1400 | 1800 |
| Depth [mm] | 850 | 850 |
| Weight [kg] | 135 | 140 |

7.18.7 Switchgear, Circuit Breaker Function (Option)

| | | |
|--------------------|------|------|
| Rated voltage [Kv] | 24 | 36 |
| Width [mm] | 480 | 600 |
| Height [mm] | 1400 | 1800 |
| Depth [mm] | 850 | 850 |
| Weight [kg] | 218 | 238 |

7.18.8 Towers

| | |
|--|-------|
| 3-parted, modular tower (80 m IEC I / DiBt III): | 160 t |
| 5-parted, modular tower (105 m DiBt II): | 235 t |

8. General Reservations, Notes and Disclaimers

- All data are valid at sea level ($\rho=1.225 \text{ kg/m}^3$).
- Periodic operational disturbances and generator power de-rating may be caused by a combination of high winds, low voltage or high temperature.
- Vestas recommends that the electrical grid is as close to nominal as possible with little variation in frequency.
- A certain time allowance for turbine warm-up must be expected following a grid dropout and/or periods of very low ambient temperature.
- If the wind turbine is sited at elevations greater than 1000 m (3300 ft) above sea level, a higher temperature rise than usual may occur in the electrical components. In such cases, a periodic power reduction from rated electrical output may occur. This may occur even when the ambient temperature remains within specified limits.
- Furthermore, sites situated more than 1000 m (3300 ft.) above sea level usually experience an increased risk of icing in most climates.
- Because of continuous development and product upgrade, Vestas reserves the right to change or alter these specifications at any time.
- All listed start/stop parameters (e. g. wind speeds and temperatures) are equipped with hysteresis control. This can, in certain borderline situations, result in turbine stops even though the ambient conditions are within the listed operation parameters.
- Vestas Optispeed™ technology is not available in the United States of America and Canada.